



November 8, 2018

Mr. Clifford Schrock
SUNMODO
14800 NE 65th St.
Vancouver, WA 98682

Project Number 1180828C

Subject: EZ 1" Standard Standing Seam Clamp with L-Foot Laboratory Load Testing
Part #K50200-001 Attached to 24ga EZ Lock by Taylor Systems

Dear Mr. Schrock:

As requested, Applied Materials & Engineering, Inc. (AME) has completed load-testing the EZ 1" Standard Standing Seam Clamp, (Part #K50200-001) with L-Foot; see Appendix A, Figure A1. The purpose of our testing was to evaluate the tensile (uplift) and lateral (shear) load capacity of the EZ 1" Standard Standing Seam Clamp attached to a 24ga EZ Lock roofing sample manufactured by Taylor Systems.

SAMPLE DESCRIPTION

Mockup samples were delivered to our laboratory on October 19, 2018. Mockup configuration consists of a 1/2" Structural I plywood test sample reinforced with a 2"x4" wood frame to minimize the flexing of the plywood. The 24ga EZ Lock roofing sample is fastened to a 2"x4" wood rafter through the Structural I plywood via 3/8"Øx2.5" lag screws. The EZ 1" Standard Standing Seam Clamp with L-Foot is attached to the 24ga EZ Lock roofing sample via two M10 set screws. The test samples can be seen in Appendix B.

TEST PROCEDURES & RESULTS

1. Tensile (Uplift) Load Test

A total of three tests were conducted for tensile (uplift) load capacity on October 22, 2018 using a United Universal testing machine. Samples were rigidly attached to the testing machine and an uplift (tensile) load was applied to each clamp. The samples were loaded in tension at a constant rate of axial deformation of 0.10 in. /min. without shock until failure occurred; deflection at maximum load was recorded.

Based on the above testing, the average maximum uplift load of the EZ 1" Standard Standing Seam Clamp with L-Foot attached to a 24ga EZ Lock roofing sample by Taylor Systems was determined to be 414 lbf. Detailed results are provided in Table I and Figure 1. Test setup and mode of failure are provided in Appendix B, Figure B1.

NOTE: THESE LOADS SHOW NO FACTOR OF SAFETY (FOS). A FOS = 2 IS RECOMMENDED FOR LOAD CAPACITY VALUES.

Mr. Clifford Schrock

Project Number 1180348C

SUNMODO

EZ 1" Standard Standing Seam Clamp with L-Foot

Part #K50200-001 Laboratory Load Testing

November 8, 2018

2. Lateral (Shear) Load Test Parallel to Rafter and Seam

A total of three tests were conducted for lateral (shear) load capacity on October 23, 2018 using a United Universal testing machine. Samples were rigidly attached to the testing machine and a shear load (parallel to the rafter and roofing sample seam) was applied to each clamp. The samples were loaded in a downward direction at a constant rate of axial deformation of 0.10 in. /min. without shock until failure occurred; displacement at maximum load was recorded.

Based on the above testing, the average maximum shear load of the EZ 1" Standard Standing Seam Clamp with L-Foot attached to a 24ga EZ Lock roofing sample by Taylor Systems was determined to be 586 lbf. Detailed results are provided in Table II and Figure 2. Test setup and mode of failure are provided in Appendix B, Figure B2.

Respectfully Submitted,

APPLIED MATERIALS & ENGINEERING, INC.

Joseph Gapuz

Joseph Gapuz
Laboratory Manager



Reviewed by:

Armen Tajirian
Armen Tajirian, Ph.D., P.E.
Principal

NOTE: THESE LOADS SHOW NO FACTOR OF SAFETY (FOS). A FOS = 2 IS RECOMMENDED FOR LOAD CAPACITY VALUES.

TABLE I


TENSILE (UPLIFT) LOAD TEST RESULTS

EZ 1" STANDARD STANDING SEAM CLAMP w/ L-FOOT
(PART #K50200-001)

PROJECT NUMBER 1180828C

TEST NUMBER	MAXIMUM TENSILE LOAD (lbf)	DEFLECTION AT MAXIMUM LOAD (in.)	MODE OF FAILURE
2546	435	0.2	Seam Clamp Slippage
2463	405	0.1	
2545	402	0.2	
AVERAGE	414	0.2	..

FIGURE 1

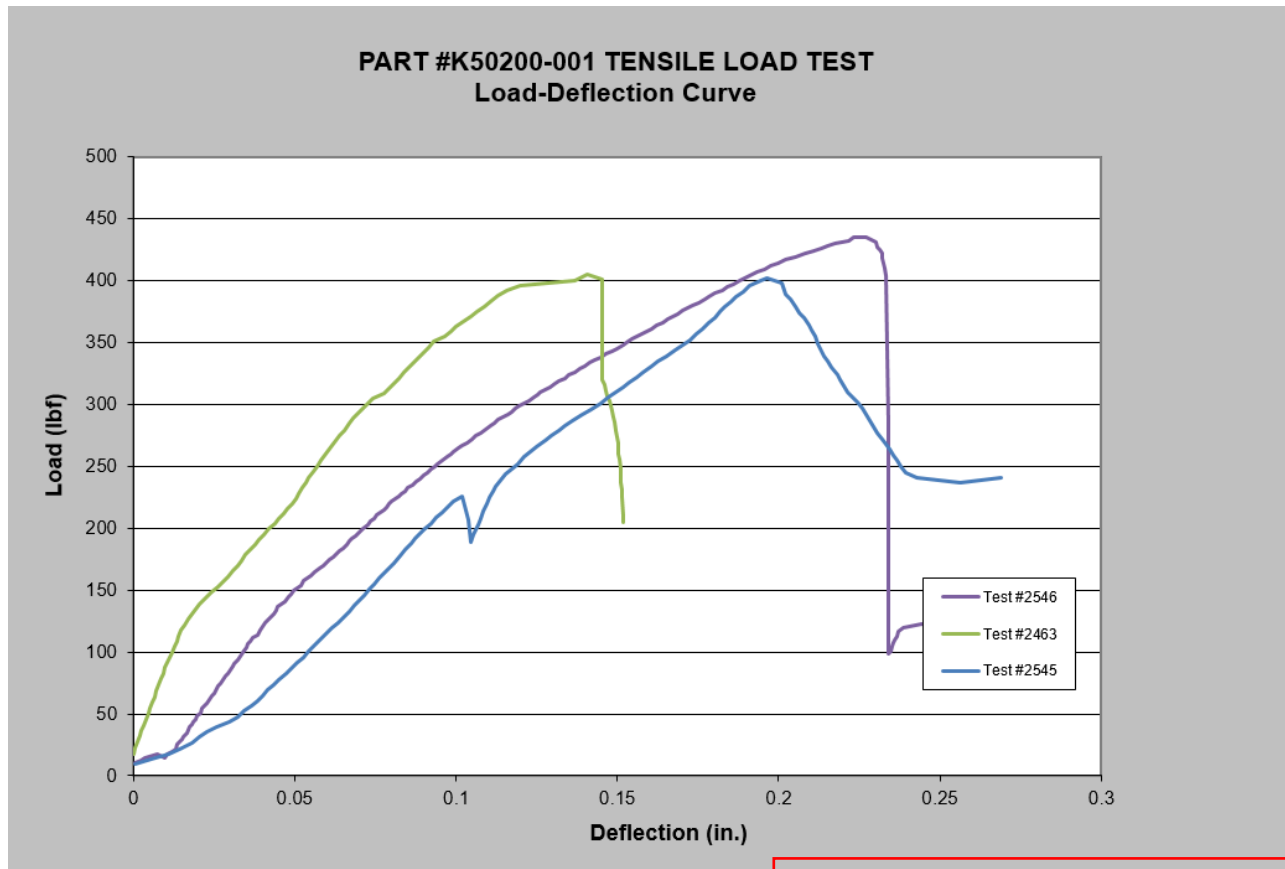

NOTE: THESE LOADS SHOW NO FACTOR OF SAFETY (FOS). A FOS = 2 IS RECOMMENDED FOR LOAD CAPACITY VALUES.

TABLE II


LATERAL (SHEAR) LOAD TEST RESULTS

EZ 1" STANDARD STANDING SEAM CLAMP w/ L-FOOT
(PART #K50200-001)

PROJECT NUMBER 1180828C

TEST NUMBER	MAXIMUM SHEAR LOAD (lbf)	DEFLECTION AT MAXIMUM LOAD (in.)	MODE OF FAILURE
2551	622	0.7	Seam Clamp Slippage
2552	533	0.4	
2553	603	0.4	
AVERAGE	586	0.5	..

FIGURE 2

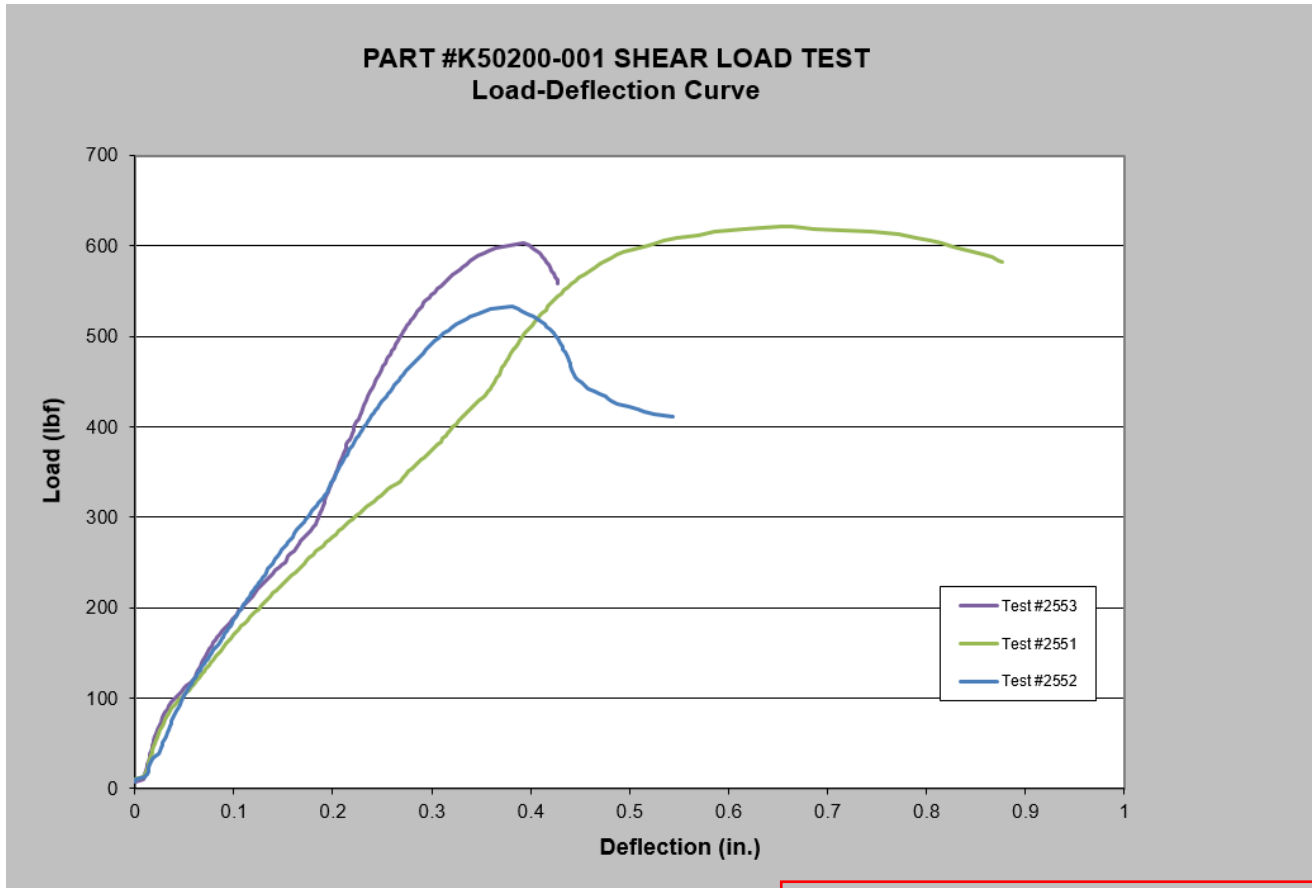

NOTE: THESE LOADS SHOW NO FACTOR OF SAFETY (FOS). A FOS = 2 IS RECOMMENDED FOR LOAD CAPACITY VALUES.

REFERENCES

AC13-2010, “*Acceptance Criteria for Joist Hangers and Similar Devices*”, ICC Evaluation Service.






AC85-2008, “*Acceptance Criteria for Test Reports*”, ICC Evaluation Service.

APPENDIX A

FIGURE A1

**EZ 1" STANDARD STANDING SEAM CLAMP w/ L-FOOT
(PART #K50200-001)**

PROJECT NUMBER 1180828C

			
EZ STANDING SEAM ROOF CLAMPS			
			
1" SEAM CLAMP STANDARD K50200-001	1" SEAM CLAMP MINI K50200-002	2" SEAM CLAMP STANDARD K50210-001	2" SEAM CLAMP MINI K50210-002
Competitors Clamps			
Ace A2 Ace A2-N S-5-B S-5-E S-5-N S-5-R465 S-5-S S-5-U S-5-V S-5-Z	Ace A2 Ace A2-N S-5-B Mini S-5-E Mini S-5-N Mini S-5-R465 Mini S-5-S Mini S-5-U Mini S-5-V Mini S-5-Z Mini	Ace ML S-5-H S-5-H90 S-5-N 1.5 S-5-Q S-5-S S-5-T S-5-U S-5-V S-5-Z	Ace ML S-5-H Mini S-5-H90 Mini S-5-N 1.5 Mini S-5-Q Mini S-5-S Mini S-5-T Mini S-5-U Mini S-5-V Mini S-5-Z Mini
SunModo Corp Vancouver, WA 360-844-0048 Document Number D10126-V001 ©2018 – SunModo Corp.			

APPENDIX B

FIGURE B1

EZ 1" STANDARD STANDING SEAM CLAMP w/ L-FOOT
(PART #K50200-001)

TENSILE LOAD TEST SETUP

PROJECT NUMBER 1180828C



Figure B1a. Test Setup



Figure B1b. Typical Failure Mode

FIGURE B2

EZ 1" STANDARD STANDING SEAM CLAMP w/ L-FOOT
(PART #K50200-001)

LATERAL (SHEAR) LOAD TEST SETUP

PROJECT NUMBER 1180828C



Figure B2a. Test Setup



Figure B2b. Typical Failure Mode